


HEELEY

HEELEY LED Emergency Downlight, IP20, Non-maintained, Replaceable Lens, LiFePO4

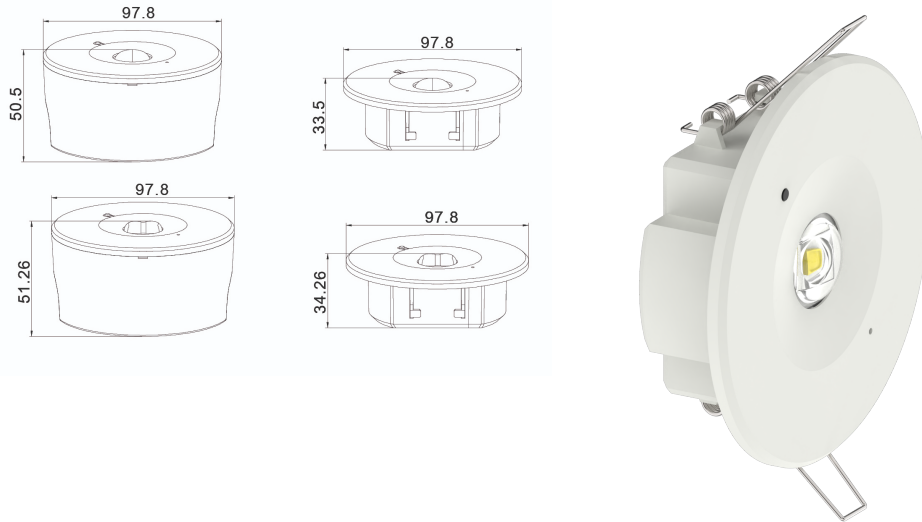

GENERAL DATA

Light Source	LED
Light Source Replaceable	No
Colour/Finish	White RAL 9016
Material	Polycarbonate
IP Rating	IP20
IK Rating	IK04
Mounting Type	Surface or Recessed
Warranty (Years)	5
Life Time Hours	50,000

DIMENSIONS & WEIGHT

Depth (mm)	34mm Recessed / 51mm Surface
------------	------------------------------

BLE LIGHTING AND POWER LTD

Unit 3, Drake Business Park, Drake House Crescent, Sheffield, S20 7HT
T: 01246 432325, E: sales@blelighting.co.uk, W: www.blelighting.co.uk

This document is uncontrolled if printed, all information is subject to change. Generated on 18/11/25

Diameter (mm)	98
Cut Out (mm)	75-90
Weight (g)	137

ELECTRICAL

Input Voltage (V)	220-240
Input Frequency (Hz)	50
Wattage (W)	2
Classification	Class II
Operating Temperature (°C)	+5 to +35
Power Factor	0.4

OPTICAL

Colour Temperature	6500K
CRI	80
Beam Angle (°)	Horizontal: 145° / Vertical: 136°

EMERGENCY

Battery Type	LiFePO4 3.2V
Battery Capacity	1.5Ah
Battery Warranty (Years)	5
Recharge Time (hrs)	24
Battery Replaceable	No
Mode of Operation	Non-maintained
Test Procedure	Manual
Emergency Duration (hrs)	3
Lumen Output Emergency (lm)	150

STANDARDS & APPROVALS

Manufactured in Accordance with	BS EN 60598-1, BS EN 60598-2-22
CE Mark	Yes
UKCA Mark	Yes
WEEE Symbol	Yes
Accredited Members	ISO 9001, LIA, ICEL

PACKAGING

BLE LIGHTING AND POWER LTD

Unit 3, Drake Business Park, Drake House Crescent, Sheffield, S20 7HT
T: 01246 432325, E: sales@blelighting.co.uk, W: www.blelighting.co.uk

This document is uncontrolled if printed, all information is subject to change. Generated on 18/11/25

Packaging Length (mm)	101
-----------------------	-----

Packaging Width (mm)	101
----------------------	-----

Packaging Depth (mm)	62
----------------------	----

BLE LIGHTING AND POWER LTD

Unit 3, Drake Business Park, Drake House Crescent, Sheffield, S20 7HT
T: 01246 432325, E: sales@blelighting.co.uk, W: www.blelighting.co.uk

This document is uncontrolled if printed, all information is subject to change. Generated on 18/11/25